


**NOTES:**

1. DEPENDING ON CONDITIONS, WHERE A CHAIN TYPE TRENCHER IS UTILIZED SAND MAY NOT BE REQUIRED. HOWEVER WHERE EXCAVATION IS COMPLETED BY A HOE OR SIMILAR MEANS, SAND MUST BE PROVIDED 150mm BELOW AND 300mm ABOVE CABLE.
2. SERVICE CABLE TO BE MINIMUM 1.0 m, MAXIMUM 1.3 m IN DEPTH.
3. INSTALLATION MUST BE INSPECTED PRIOR TO COMPLETE BACKFILLING (INSTALL CABLE, SAND AND FILL, UP TO MARKER TAPE THEN CALL FOR INSPECTION). IF MULTIPLE INSPECTIONS ARE REQUIRED THERE WILL BE ADDITIONAL CHARGES.
4. CABLE MUST BE PROTECTED FROM MECHANICAL DAMAGE AT ALL TIMES.

20170503 09:23 r lawrie

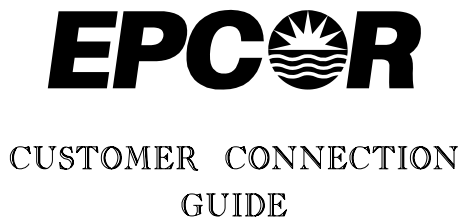

TYPICAL UNDERGROUND RESIDENTIAL SERVICE INSTALLATION ON PROPERTY

DATE REVISED:  
2017-05-03

DRAWING NO. :  
002

REFERENCE NO.  
66 CC 07 02 47 010

PAGE NO.  
1 / 1