


NOTES:

1. FOR METERS INSTALLED BELOW GRADE, A 1" CONDUIT SHALL BE INTALLED TO AN EXTERIOR JUNCTION BOX. IN ADDITION ONE 120 V 15 A DUPLEX RECEPTACLE MUST BE PROVIDED.

20170329 13:54 r lawrie

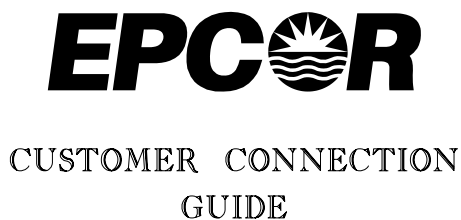

INSTRUMENT TRANSFORMER METERING LAYOUT

DATE REVISED:
2017-03-29

DRAWING NO. :
022

REFERENCE NO.
65 CC 07 00 90 100

PAGE NO.
1 / 1