


4.0m X 6.0m RIGHT-OF-WAY REQUIREMENT

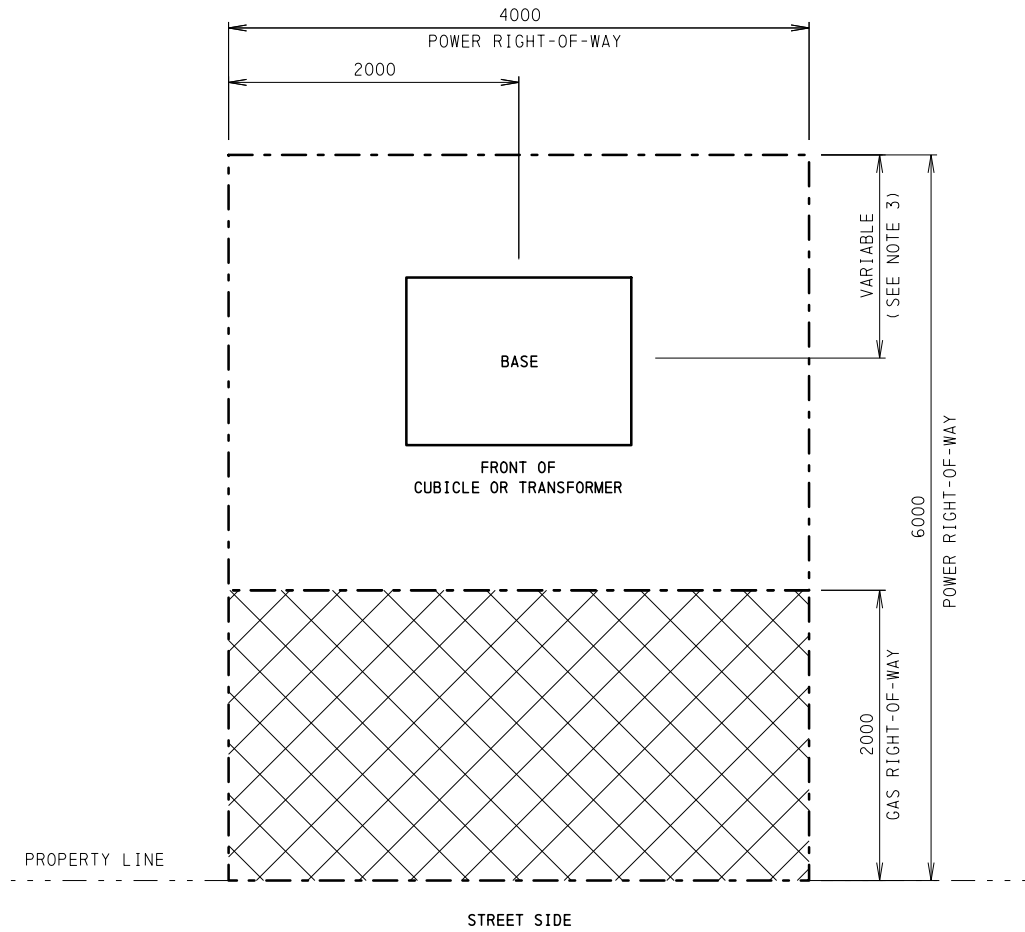


NOTES:

1. HOTSTICK OPERATIONS REQUIRE 3.0m UNOBSTRUCTED ACCESS.
2. FRONT OF CUBICLE OR TRANSFORMER TO FACE STREET.
3. REFER TO SWITCHING CUBICLE BASE AND TRANSFORMER BASE INSTALLATION DRAWINGS FOR DETAILS.
4. GUARD RAIL IS REQUIRED WHEN A CUBICLE OR TRANSFORMER IS INSTALLED ON PRIVATE PROPERTY.

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.

20170126 11:47 rlawrie

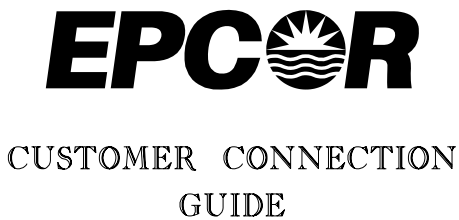

RIGHT-OF-WAY REQUIREMENT FOR SINGLE
PHASE SWITCHING CUBICLE, SINGLE PHASE
TRANSFORMER OR 3 PHASE TRANSFORMER
WITH 2.0 m GAS RIGHT-OF-WAY

DATE REVISED:
2016-11-14

DRAWING NO. :
026

REFERENCE NO.
60 CC 07 00 12 002

PAGE NO.
1 / 1