


4.0m X 9.0m RIGHT-OF-WAY REQUIREMENT

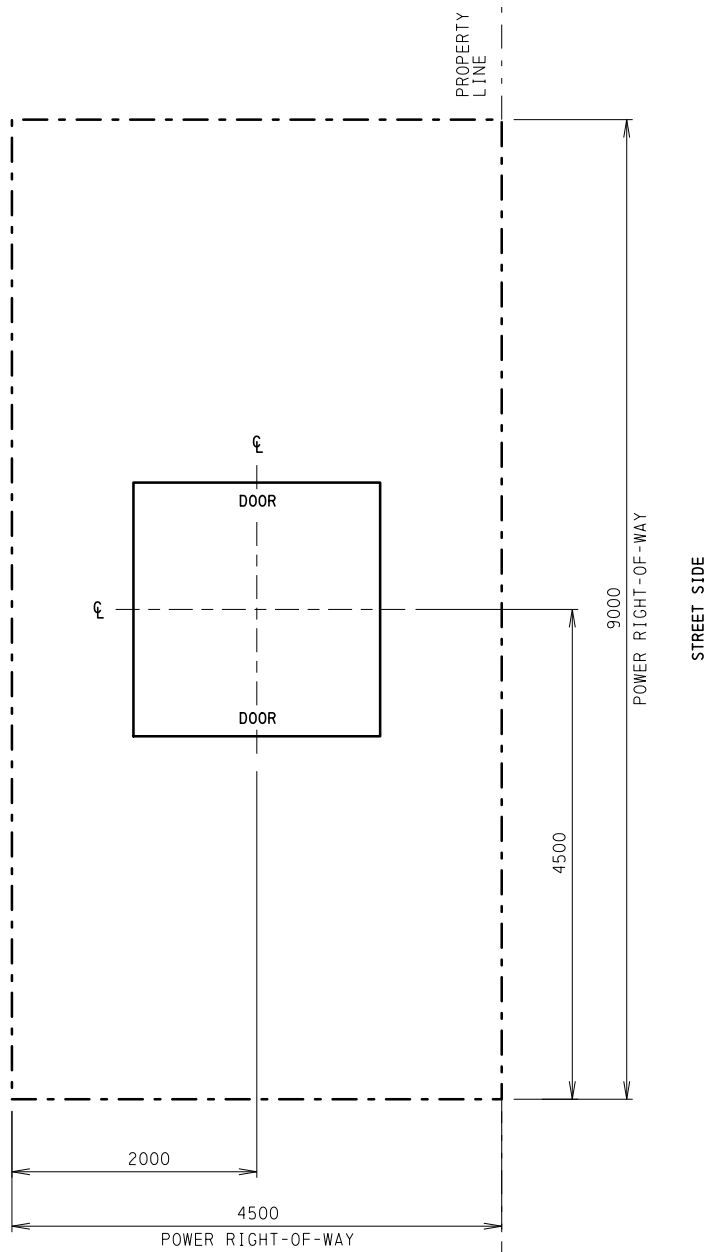


NOTES:

1. HOTSTICK OPERATIONS REQUIRE 3.0m UNOBSTRUCTED ACCESS.
2. REFER TO SWITCHING CUBICLE BASE INSTALLATION DRAWINGS FOR DETAILS.
3. GUARD RAIL IS REQUIRED WHEN A CUBICLE IS INSTALLED ON PRIVATE PROPERTY.

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.

20170126 11:51 r lawrie

| | | | |
|---|----------------------|---|-------------------|
|  <p>CUSTOMER CONNECTION GUIDE</p> | | <p>RIGHT-OF-WAY REQUIREMENT FOR 3 PHASE SWITCHING CUBICLE</p> | |
| DATE REVISED: 2017-01-24 | DRAWING NO. : 027 | REFERENCE NO. 60 CC 07 00 12 005 | PAGE NO. 1 / 1 |