


# 6.0m X 9.0m RIGHT-OF-WAY REQUIREMENT

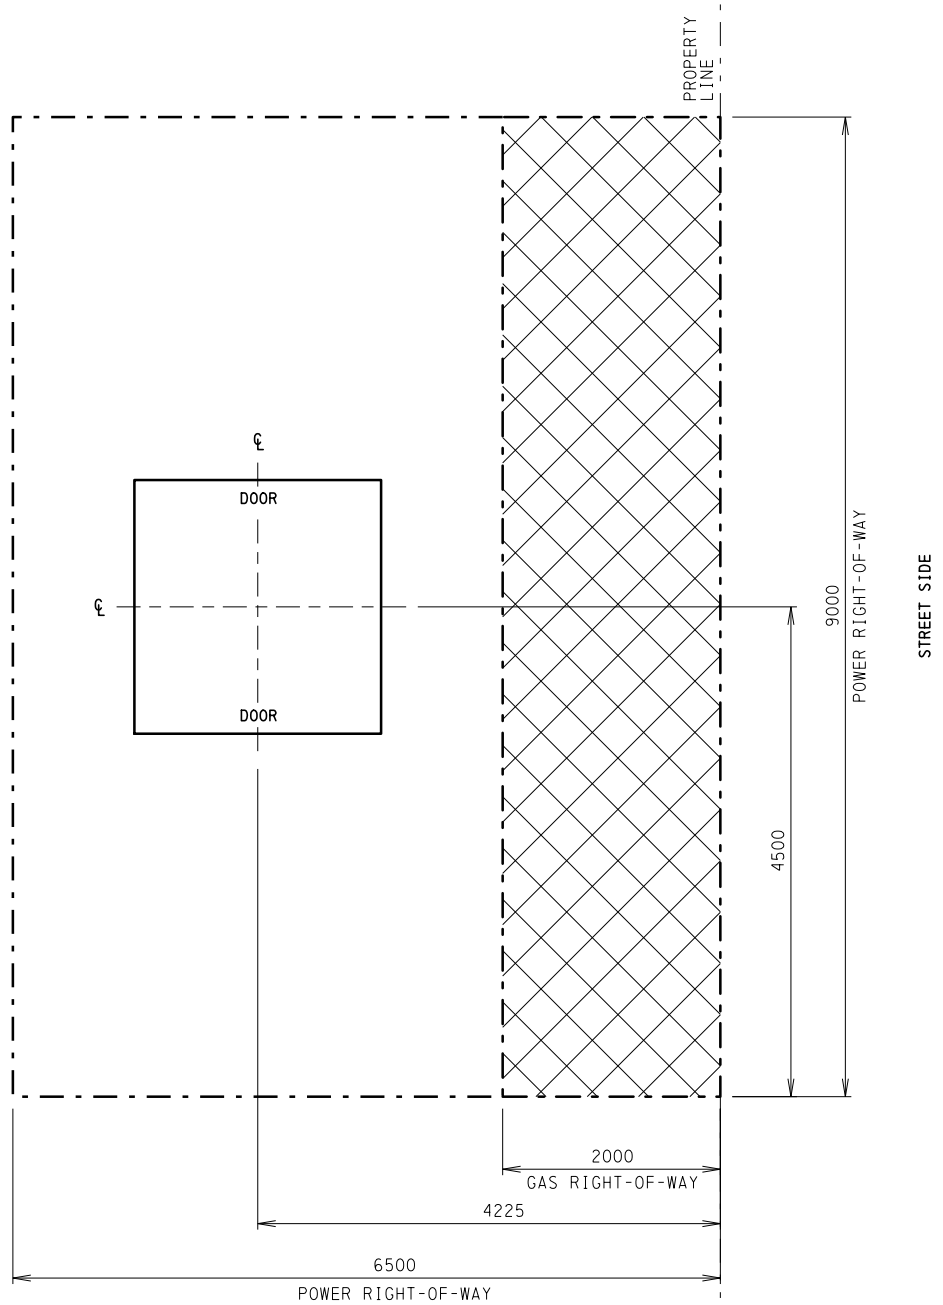


**NOTES:**

1. HOTSTICK OPERATIONS REQUIRE 3.0m UNOBSTRUCTED ACCESS.
2. REFER TO SWITCHING CUBICLE BASE INSTALLATION DRAWINGS FOR DETAILS.
3. GUARD RAIL IS REQUIRED WHEN A CUBICLE IS INSTALLED ON PRIVATE PROPERTY.

ALL DIMENSIONS ARE IN MILLIMETERS (INCHES) UNLESS OTHERWISE SPECIFIED.

20170126 13:56 r lawrie

 <p><b>CUSTOMER CONNECTION GUIDE</b></p>		<p>RIGHT-OF-WAY REQUIREMENT FOR 3 PHASE SWITCHING CUBICLE WITH 2.0 m GAS RIGHT-OF-WAY</p>	
DATE REVISED: 2017-01-24	DRAWING NO. : 028	REFERENCE NO. 60 CC 07 00 12 006	PAGE NO. 1 / 1