


**DRAWING 10:
GROUND GRID REQUIREMENTS FOR 15 KV 25 KV
SWITCHING CUBICLES AND THREE-PHASE
TRANSFORMERS NEXT TO EACH OTHER**



NOTE:

1. 3000 mm CLEARANCE REQUIRED IN FRONT OF ANY DOOR FOR HIGH VOLTAGE OPERATION.

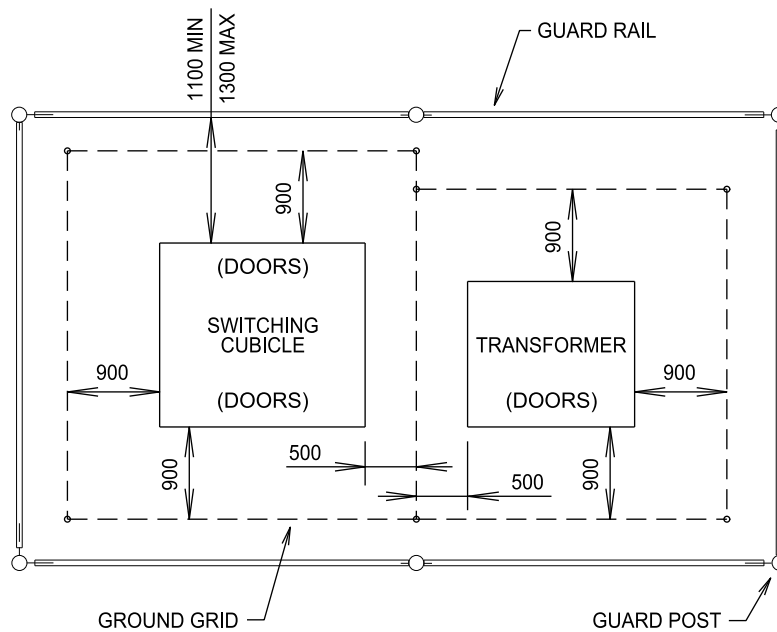

**CUSTOMER CONNECTION
GUIDE**

GROUND GRID REQUIREMENTS FOR 15 KV ;
25 KV SWITCHING CUBICLES AND THREE
PHASE TRANSFORMERS NEXT TO EACH OTH

E REVISED:
2017-01-23

DRAWING NO. :
010

REFERENCE NO.
66 CC 07 00 60 002