


**DRAWING 12:  
SAMPLE OF SUBMISSION FOR  
MULTI-FAMILY DEVELOPMENTS  
(FOR EXAMPLE PURPOSES ONLY)**

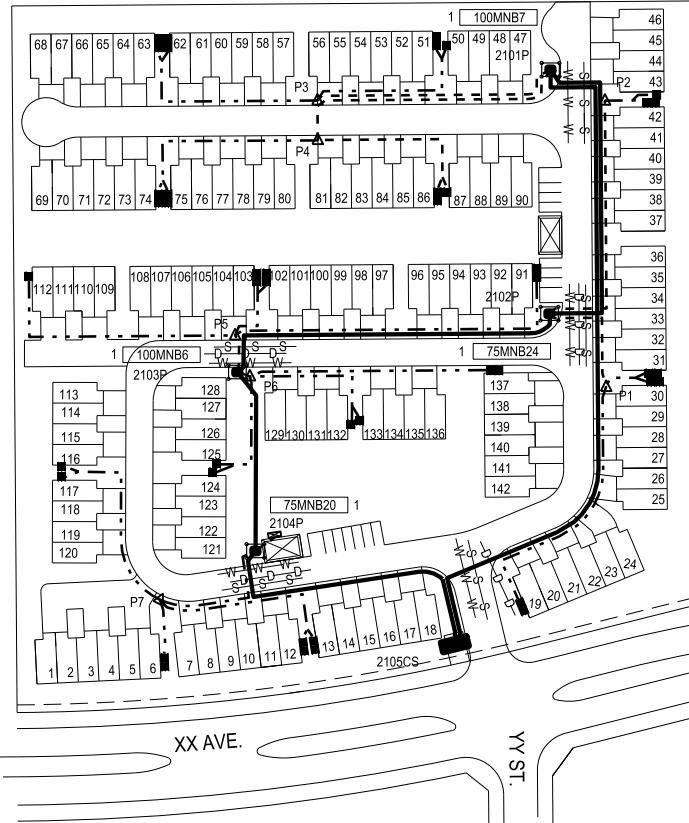

**LEGEND**

- PRIMARY CONDUCTOR  
1-100C C/W 1-1/C #1/0 AL XLPE 25KV
- - - SECONDARY CONDUCTOR  
2-100C E/W 1-2/C #4/0 AL XLPE
- · · SECONDARY CONDUCTOR  
1-100C E/W 1-2/C #4/0 AWG AL XLPE
- · · · SECONDARY CONDUCTOR  
1-100C C/W 1-2/C #2/0 AL XLPE  
TO EACH FOUR GANG METER BASE
- WP HOUSE PANEL AND METER
- △ SERVICE PEDESTAL  
P7 C/W 2P-400A MAIN BREAKER  
ALL OTHERS C/W 2P-400A MAIN BREAKER
- ▣ PADMOUNTED TRANSFORMER  
C/W POSTS & GUARDRAIL
- SWITCHING CUBICLE
- FOUR GANG METER BASE
- U- UTILITIES  
W- WATER  
D- DRAINAGE  
S- SEWER

**NOTES:**

1. INDIVIDUAL SERVICE CABLES NOT SHOWN ON THIS EXAMPLE
2. DUCT IS REQUIRED UNDER ROADWAYS AND DRIVEWAYS
3. FOR SITES WITH MORE THAN TWO TRANSFORMERS A PRIMARY LOOP IS REQUIRED



**CUSTOMER CONNECTION  
GUIDE**

**SAMPLE OF SUBMISSION FOR MULTI-FAMILY  
DEVELOPMENTS  
(FOR EXAMPLE PURPOSES ONLY)**

DATE REVISED: 2014-09-29	DRAWING NO. : 012	REFERENCE NO. 60 CC 07 00 23 001	PAGE NO. 1 / 1
-----------------------------	----------------------	-------------------------------------	-------------------