



**DRAWING 18- PART 1:
TYPICAL UNDERGROUND RESIDENTIAL SERVICE
INSTALLATION FOUR PARTY TRENCH
(POWER, GAS, PHONE & CATV)**

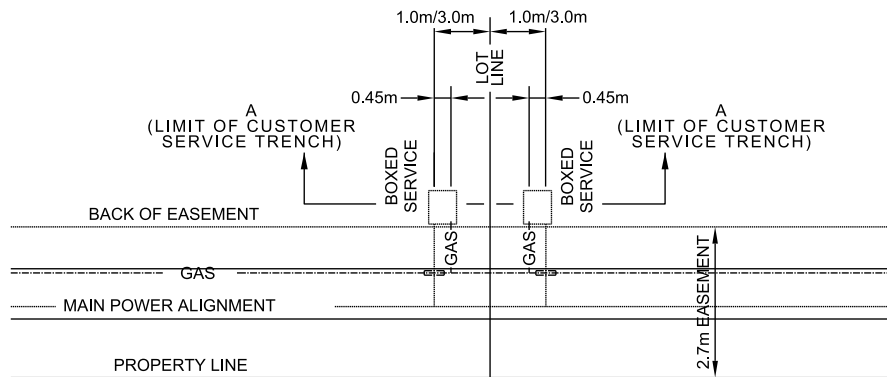


USE OF 4-PARTY SERVICE
TRENCH WITH PRIOR
APPROVAL FROM EDTI

LOT SERVICE DETAIL
N.T.S.

 CUSTOMER CONNECTION GUIDE		TYPICAL UNDERGROUND RESIDENTIAL SERVICE INSTALLATION FOUR PARTY TRENCH (POWER, GAS, PHONE & CATV)	
DATE REVISED: 2016-11-24	DRAWING NO. : 018	REFERENCE NO. 66 CC 07 02 47 011	PAGE NO. 1 / 2


**DRAWING 18 - PART 2:
TYPICAL UNDERGROUND RESIDENTIAL SERVICE
INSTALLATION FOUR PARTY TRENCH
(POWER, GAS, PHONE & CATV)**

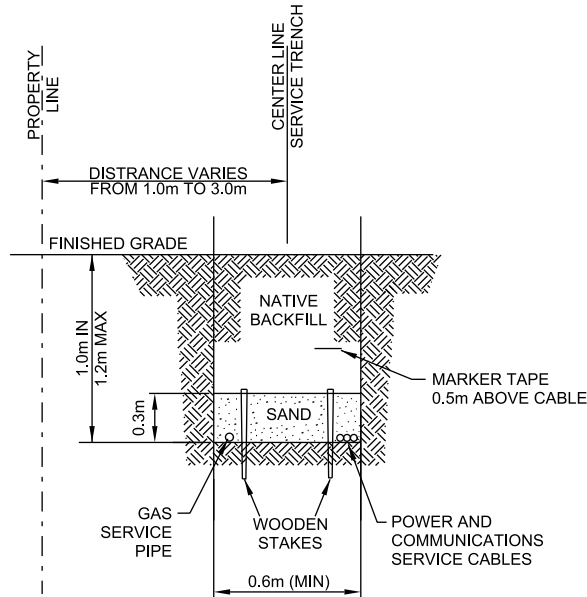

**SECTION A - A
CROSS SECTION OF SERVICE TRENCH
N.T.S.**

NOTES:

1. DEPENDING ON CONDITIONS, WHERE A CHAIN TYPE TRENCHER IS UTILIZED SAND MAY NOT BE REQUIRED. HOWEVER, WHERE EXCAVATION IS COMPLETED BY A HOE OR SIMILAR MEANS, SAND MUST BE PROVIDED 150mm BELOW AND 300mm ABOVE CABLE.
2. SERVICE CABLE TO BE MINIMUM 1000mm, MAXIMUM 1.2m IN DEPTH.
3. INSTALLATION MUST BE INSPECTED PRIOR TO COMPLETE BACKFILLING (INSTALL CABLE, SAND AND FILL, UP TO MARKER TAPE THEN CALL FOR INSPECTION). IF MULTIPLE INSPECTIONS ARE REQUIRED THERE WILL BE ADDITIONAL CHARGES.
4. CABLE MUST BE PROTECTED FROM MECHANICAL DAMAGE AT ALL TIMES.

 CUSTOMER CONNECTION GUIDE		TYPICAL UNDERGROUND RESIDENTIAL SERVICE INSTALLATION FOUR PARTY TRENCH (POWER, GAS, PHONE & CATV)	
DATE REVISED: 2016-11-24	DRAWING NO.: 018	REFERENCE NO. 66 CC 07 02 47 011	PAGE NO. 2/2