




CLASS 'A'

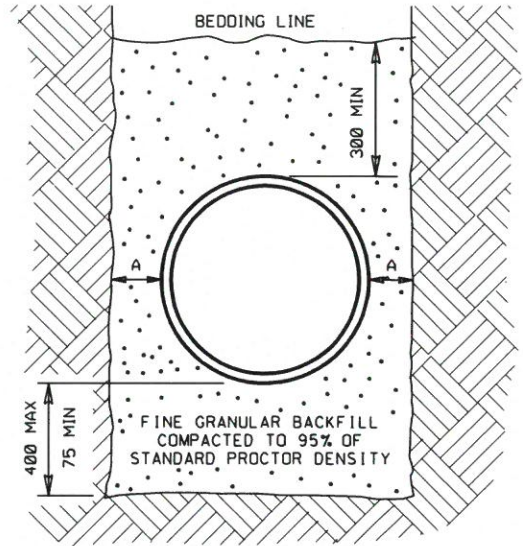

CLASS 'B'

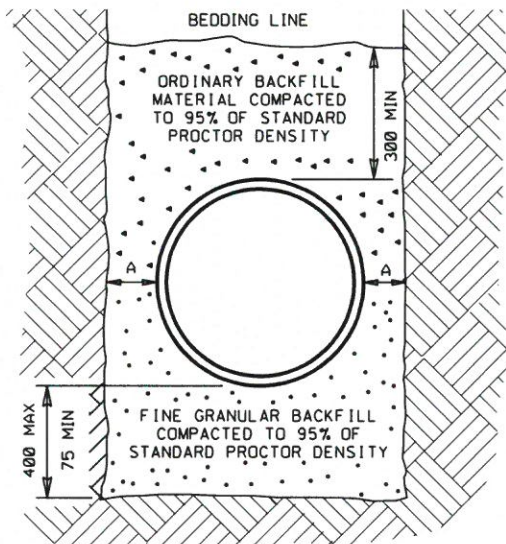

CLASS 'C'

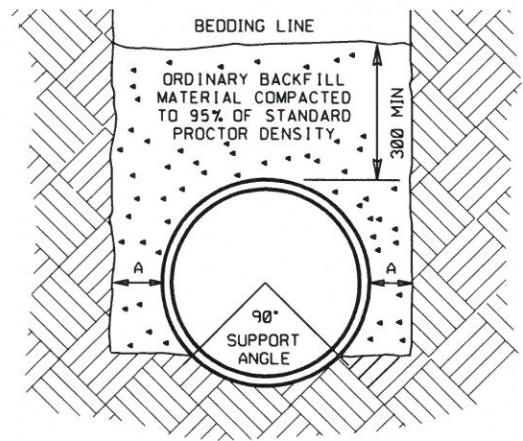



CLASS 'D'

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. ALL MATERIAL TO BE PLACED AND COMPACTED IN 150mm LAYERS.
3. WHERE INSTRUCTED OR AS SHOWN ON DRAWINGS REPLACE FINE GRANULAR WITH COARSE GRANULAR MATERIAL.
4. TRENCH WALL CLEARANCE: $200 \leq A \leq 300$
5. IF $A > 300$ BACKFILL MUST BE COMPACTED TO 100% OF STANDARD PROCTOR DENSITY.
6. APPLICABLE ONLY TO SINGLE PIPE INSTALLATIONS IN TRENCHES EXCAVATED IN UNDISTURBED GROUND
7. REFER TO SPECIFICATIONS SECTION 02515
8. UNLESS OTHERWISE INSTRUCTED USE CLASS "B" BEDDING WITH FINE GRANULAR MATERIAL

20170214 14:25 cawright.2511-2.DGN

	STANDARD TRENCH BEDDING FOR CIRCULAR PIPE			DRAWING NUMBER
	APPROVED MARCH 2017	DRAWN BY Dale Vandenberg	APPROVED 	2511-02
SCALE N T S	CHECKED BY Doug S.	DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION		REVISION 0