




COVER DEPTH m	THICKNESS mm (IN)	WIDTH (W) m
1.1 - 1.4	90 (3.5)	3.4
1.4 - 1.7	75 (3.0)	2.8
1.7 - 2.0	75 (3.0)	2.2
2.0 - 2.3	50 (2.0)	1.6
2.3 - 2.9	40 (1.5)	1.0
BELOW 2.9	-	-

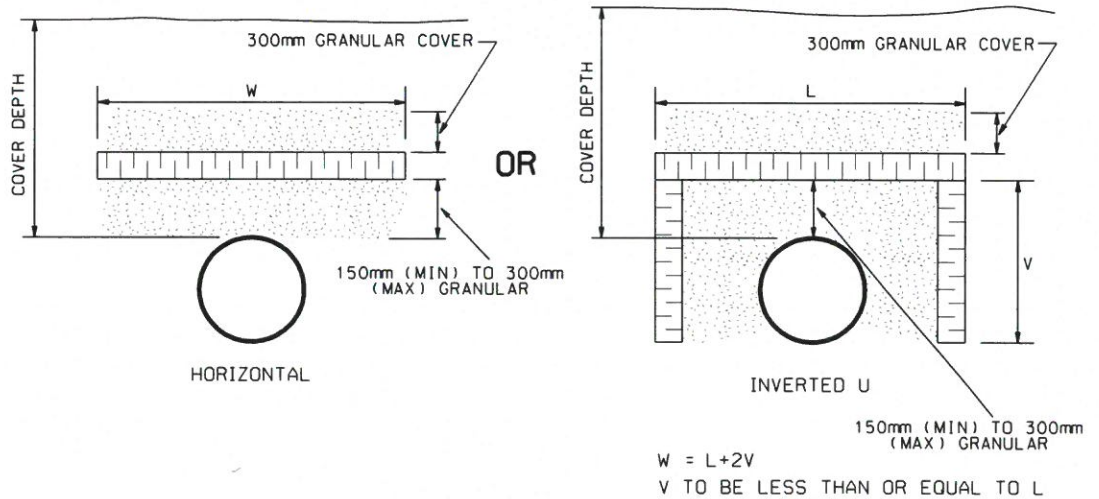

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. APPLICABLE WHEN USING FILLCRETE, GRANULAR OR CLAY BACKFILL FOR WATER MAINS WITH DEPTH OF COVER LESS THAN THE MINIMUM, AS DESCRIBED IN THE DESIGN STANDARDS, SECTION 6.2
3. USE DOW HI-40 STYROFOAM BOARD, OR APPROVED EQUAL.

20170214 14:40 cawright 2511-8.DGN

	INSULATION REQUIREMENTS FOR WATER MAINS / SERVICES		DRAWING NUMBER
	APPROVED MARCH 2017	DRAWN BY <i>Dole Vandenberg</i>	APPROVED 
SCALE N T S	CHECKED BY Doug S.	DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION	REVISION 0