


VALVE STRAPPED TO TEE WITH LUGS (PLAN VIEW)

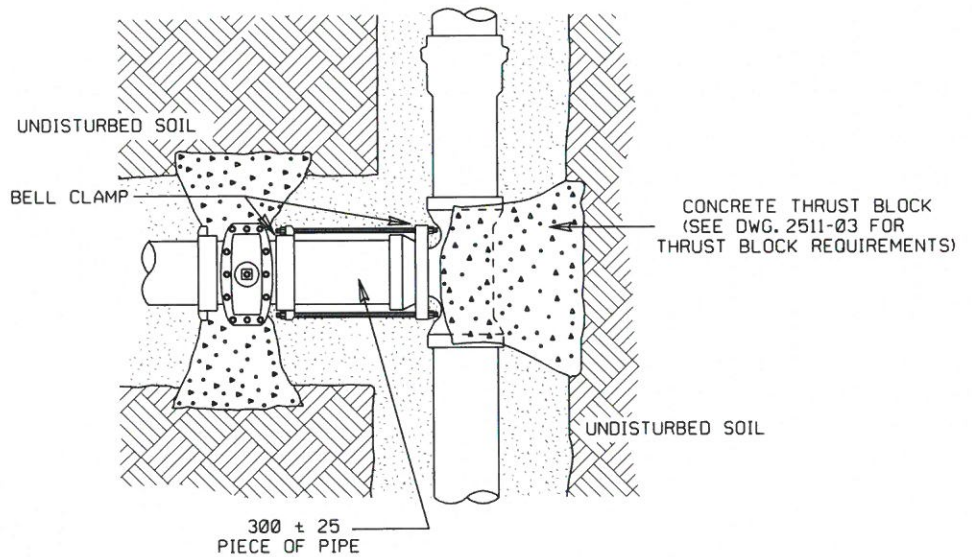

VALVE STRAPPED TO TEE WITH CLAMP (PLAN VIEW)

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. TIE RODS, WASHERS, BOLTS, TO BE STAINLESS STEEL.
3. BELL CLAMPS TO BE DUCTILE IRON.
4. CORROSION PROTECTION BY MEANS APPROVED BY THE ENGINEER.

20170214 15:17 cawright 2512-9.DGN

	VALVE STRAPPED TO TEE DETAILS			DRAWING NUMBER
	APPROVED MARCH 2017	DRAWN BY Dale Vandenberg	APPROVED 	2512-09
SCALE N T S	CHECKED BY Doug S.	DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION		REVISION 0