


20170214 15:40 cawright 2512-12.DGN

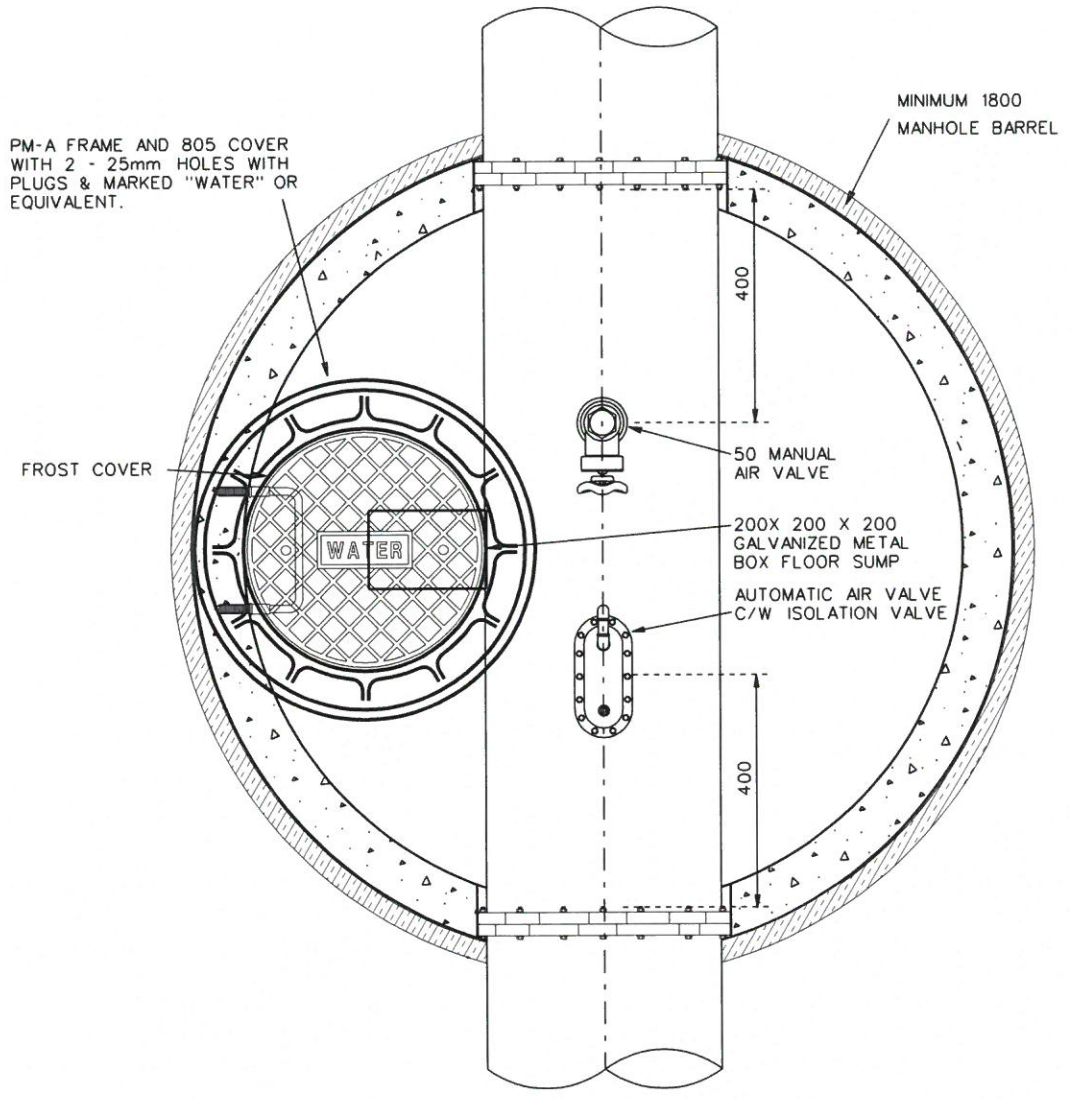

PLAN

- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
 2. INSULATE EXTERIOR OF MANHOLE AND RISER WITH 100mm THICK POLYURETHANE FOAM INSULATION. TREAT WITH APPROVED WATERPROOFING COMPOUND.
 3. ALSO SEE DRAWING 2512-13
 4. FOR STEEL AND CONCRETE CYLINDER WATER MAINS, PROVIDE ELECTRICAL ACCESS WIRES WHEN DIRECTED BY THE ENGINEER.
 5. MANUAL AIR VALVE: BRONZE OR STAINLESS STEEL GATE VALVE, 1035 kPa WORKING PRESSURE.

| | | | | |
|-------|---|---|----------|----------------|
| | AUTOMATIC AIR VALVE CHAMBER DETAIL (PLAN) | | | DRAWING NUMBER |
| | APPROVED | DRAWN BY | APPROVED | 2512-12 |
| | MARCH 2017 | Dale Vandenberg | | REVISION 0 |
| SCALE | CHECKED BY | DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION | | |
| N T S | Doug S. | | | |