


PLAN

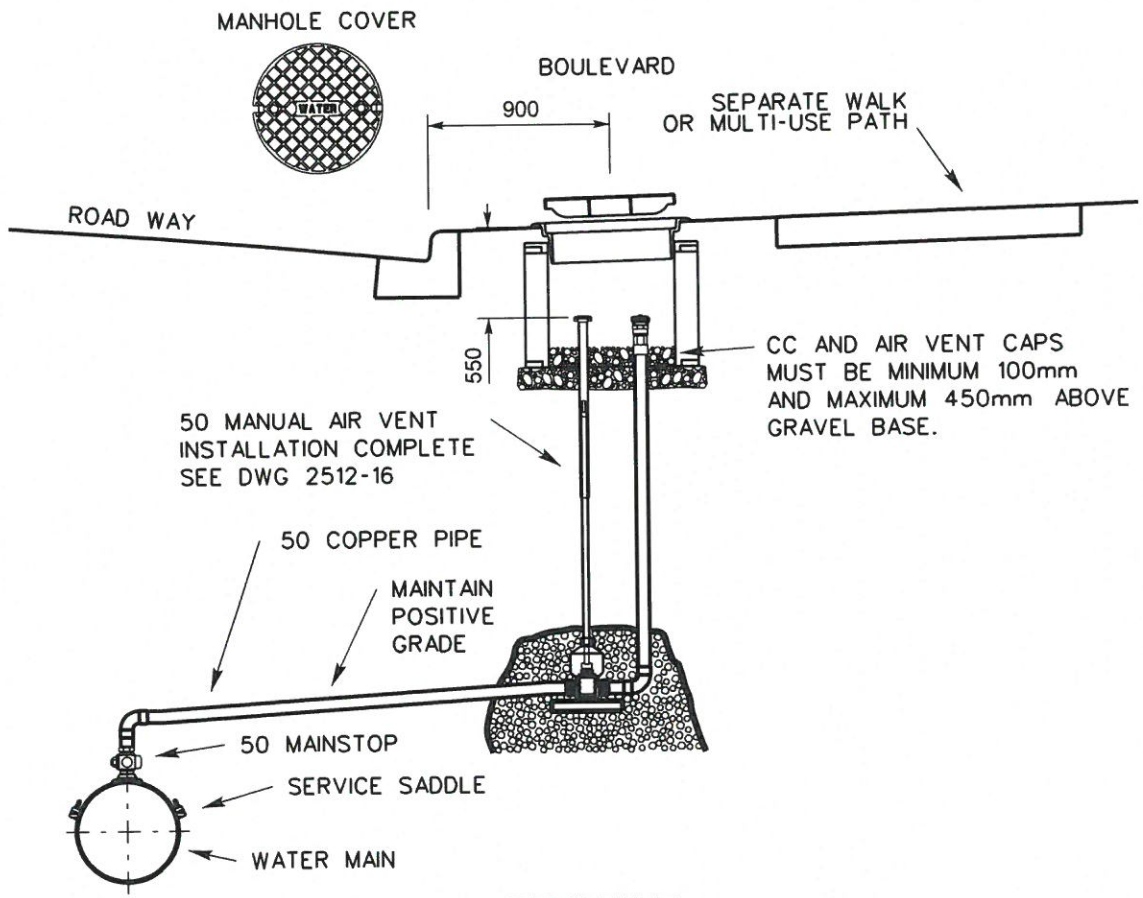

PROFILE

20170215 08:26 cawright 2512-17.dgn

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. COMPACT GRAVEL BASE TO A MINIMUM 95% OF THE MAXIMUM DENSITY IN THE BOULEVARD.
3. IF COVER ON COPPER PIPE IS 2.0m OR LESS, INSTALL INSULATION AS PER DWG 2511-08.
4. FRAME AND COVER CANNOT FALL WITHIN WALK.

| | | | | | |
|-----------------------|---|-------------------------------|---|----------------|------------|
| | TYPICAL 50mm MANUAL AIR VENT IN BOULEVARD WITH 1.5 m SEPARATE WALK | | | DRAWING NUMBER | |
| | APPROVED MARCH 2017 | DRAWN BY DV/CW | APPROVED | 2512-17 | REVISION 0 |
| SCALE N T S | | CHECKED BY David M. | DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION | | |