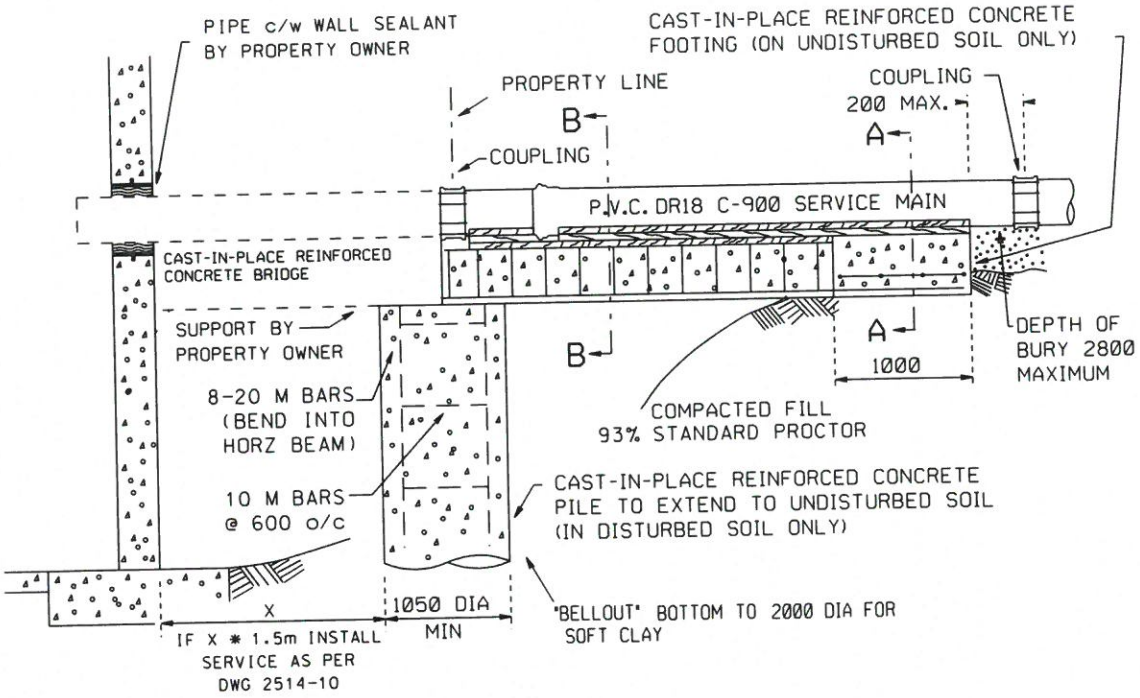

ELEVATION

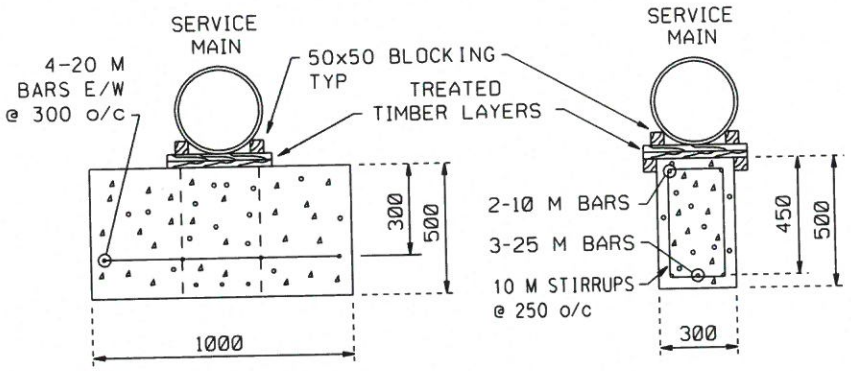

SECTION "A-A"

SECTION "B-B"

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. ALL CONCRETE TO BE 20 MPa, REBAR TO BE 300 MPa.
3. CLEAR COVER ON ALL REINFORCING STEEL TO BE 50 mm.
4. ALL CONCRETE, SULPHATE RESISTANT, HIGH EARLY STRENGTH
5. COMBINED LENGTH OF CITY AND PRIVATE BRIDGES NOT TO EXCEED 5m FOR CITY INSTALLED PILE.

20170215 10:26 cawright 2514-11.DGN

EPCOR

100mm TO 300mm WATER SERVICE FOR UNSUITABLE FOUNDATION CONDITION (BUILDING REMOVED FROM PROPERTY LINE)

APPROVED	DRAWN BY	APPROVED	DRAWING NUMBER
MARCH 2017	Dale Vandenberg	DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION	2514-11
SCALE	CHECKED BY		REVISION 0
N T S	Doug S.		