



PLAN VIEW

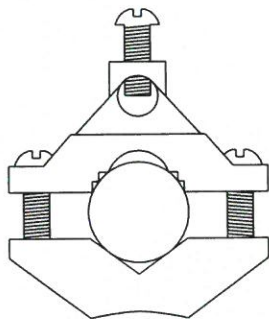

TYPICAL PIPE CLAMP

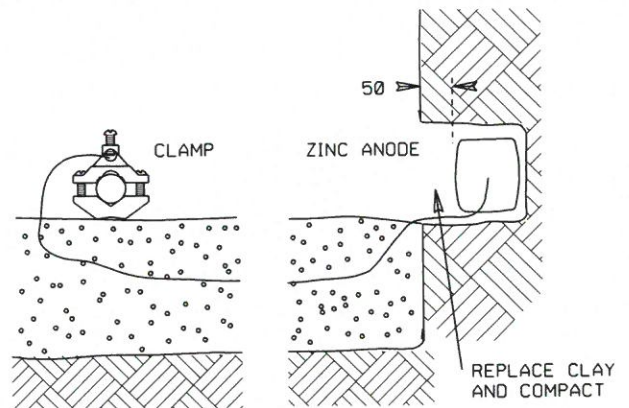

DETAIL 'A' TYPICAL

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. PIPE CLAMP TO BE ALL BRASS OR APPROVED EQUIVALENT.
3. ZINC ANODES TO BE EMBEDDED INTO TRENCH WALL TO PROVIDE FOR A MINIMUM OF 50mm OF NATIVE CLAY COMPACTED COMPLETELY AROUND ANODES.

20170215 11:07 cawright 2516-6.DGN



ANODE ON 50mm AND SMALLER COPPER WATER SERVICE

APPROVED
MARCH 2017
SCALE
N T S

DRAWN BY
Dale Vandenberg
CHECKED BY
Doug S.

APPROVED
Susan Carl
DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION

DRAWING NUMBER
2516-06
REVISION 0