




PRIMARY ANODE/WATER MAIN WIRE CONNECTION
 (TEMPORARILY DISCONNECT WHEN TAKING CURRENT MEASUREMENT)

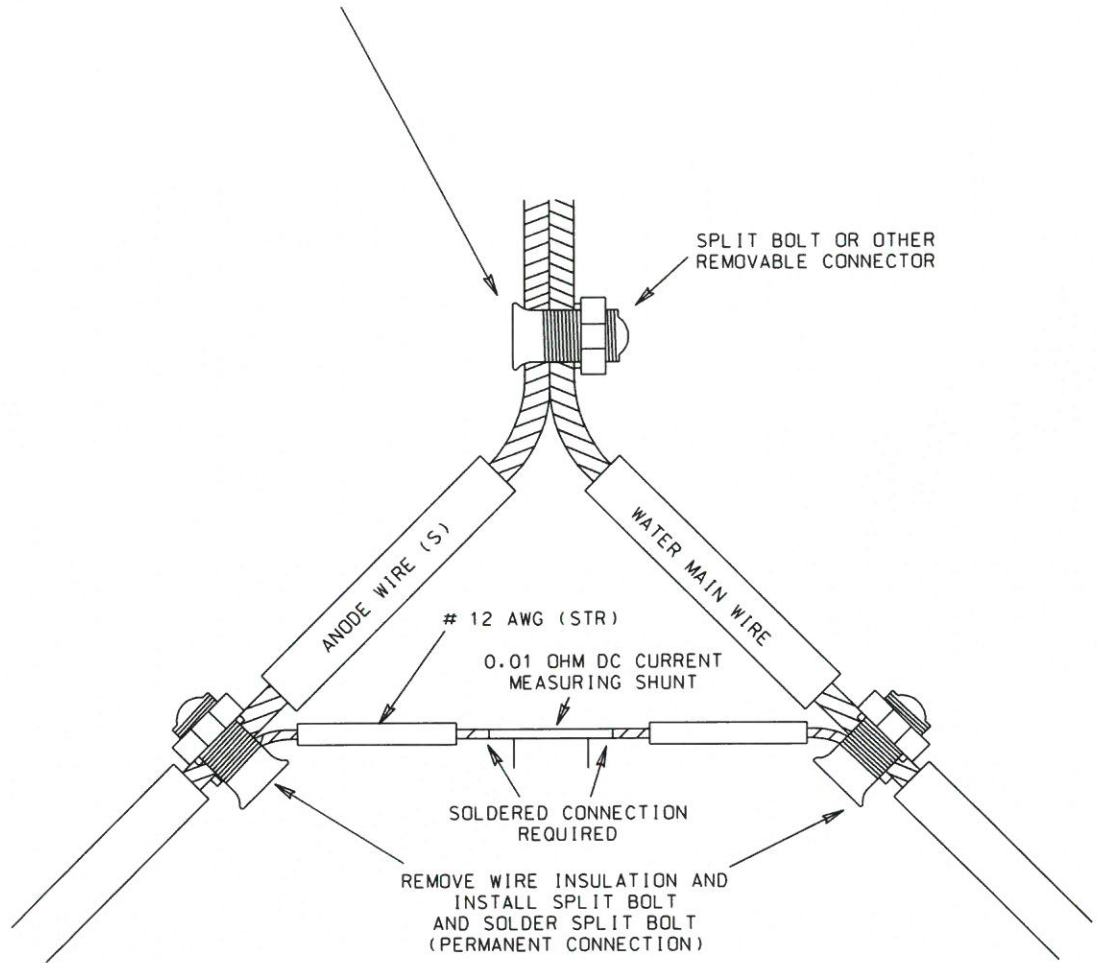

NOTES:

1. SOLDERED CONNECTIONS TO BE MADE WITH 60/40 TIN/LEAD RESIN CORE SOLDER
2. WRAP ALL CONNECTIONS WITH ELECTRICAL TAPE
3. ALWAYS RECONNECT ANODE AND WATER MAIN WIRE(S) AFTER TAKING CURRENT MEASUREMENTS

20170215 11:12 cawright 2516-8.DGN

	CATHODIC PROTECTION - TEST STATION CONNECTION FOR PIPELINES WITH INDUCED VOLTAGE		DRAWING NUMBER
	APPROVED MARCH 2017	DRAWN BY Dale Vandenberg	APPROVED 
SCALE N T S	CHECKED BY Doug S.	DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION	REVISION 0