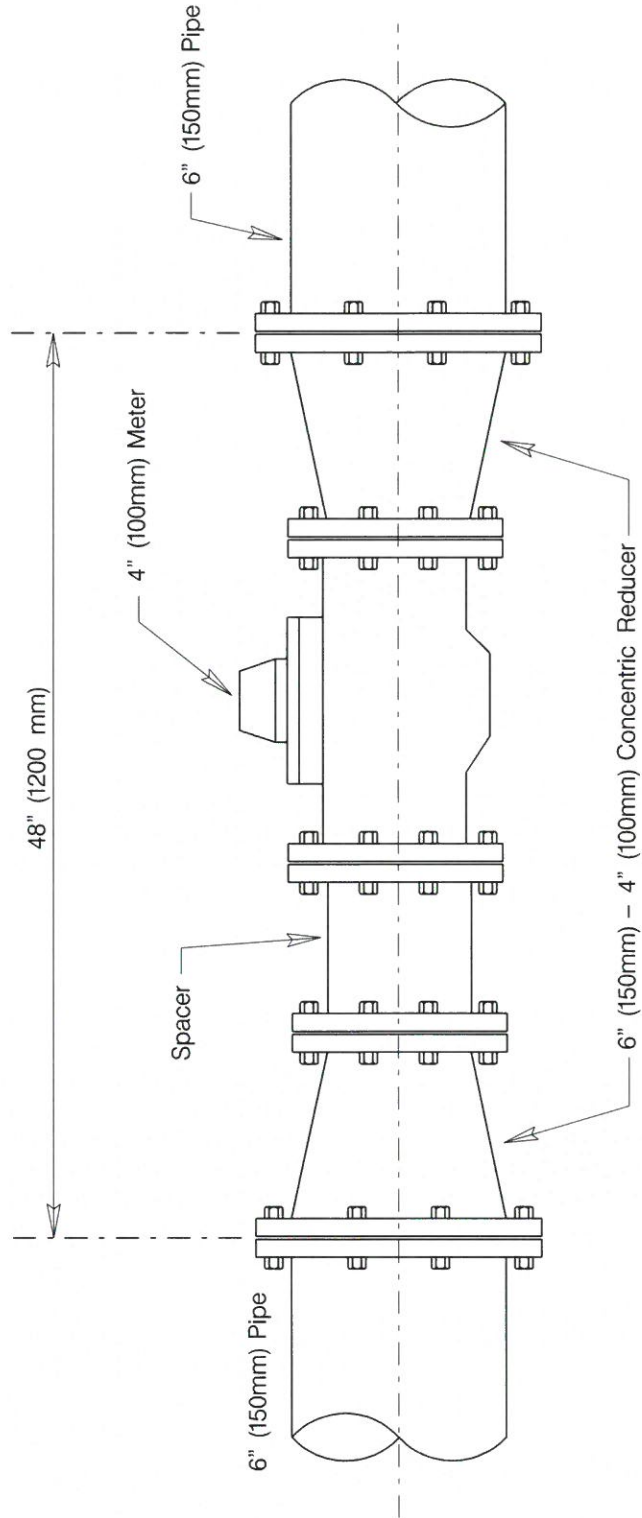




20170215 11:40 cawright.2520-08.dgn



**NOTE:**

1. Premises isolation of the water supply (fire, domestic, irrigation, other) is mandatory for all commercial, industrial, and multi-residential buildings. Approved assemblies must be selected, installed, and tested as per CSA B64.10.

|   |   |   |  |                                  |
|---|---|---|--|----------------------------------|
|  | <b>TYPICAL INSTALLATION OF A 100mm (4") WATER METER</b> |   |  |                                  |
|   | APPROVED<br><b>MARCH 2017</b>                           | DRAWN BY<br><b>DV/CW</b>                      | APPROVED<br> | DRAWING NUMBER<br><b>2520-08</b> |
| SCALE<br><b>N T S</b>   | CHECKED BY<br><b>David M.</b>                           | DIRECTOR, WATER DISTRIBUTION AND TRANSMISSION |  | REVISION<br><b>0</b>             |